

YOUR WATER AGENCY'S SOURCES OF SUPPLY

For VCMWD, your retail water supplier, the sources of water for our **29,938** customers are the Metropolitan Water District of Southern California (Metropolitan) and the San Diego County Water Authority, through the aqueduct facilities owned and operated by both Metropolitan and the San Diego County Water Authority.

Metropolitan imports water into Southern California from two sources: a 242-mile-long Colorado River Aqueduct which brings water from the Colorado River, and the 444-mile-long State Water Project California Aqueduct that carries water from the Sacramento-San Joaquin Delta to southern California. Once in the Metropolitan system, the supply is then treated at the Robert F. Skinner Filtration Plant (RFSFP) located in Western Riverside County, one of Metropolitan's seven regional filtration plants.

In December 2002, Metropolitan Water District of Southern California completed its source water assessment of its Colorado River and State Water Project supplies. Colorado River supplies are considered to be most vulnerable to recreation, urban/storm water runoff, increasing urbanization in the watershed and wastewater. State Water Project supplies are considered to be most vulnerable to urban/storm water runoff, wildlife, agriculture, recreation and wastewater. Additional information regarding this topic may be obtained at www.mwdh2o.com.

Additionally, VCMWD also receives treated water from the San Diego County Water Authority's Twin Oaks Valley Filtration Plant (TOVFP), located in San Marcos, CA. The TOVFP is fed by two sources, a variable blend of Colorado River/State Water Project water and Desalinated Sea Water from the Carlsbad "Bud Lewis" Seawater Desalination Plant located by the Encina Power Plant, 15 miles west of the TOVFP.

After treatment at the RFSFP and the TOVFP, the water flows through 7 aqueduct connections off of the 1st and 2nd SDCWA Aqueducts and the SDCWA 2A Pipeline into the VCMWD water system. Once in the VCMWD system, water is delivered through 340 miles of pressurized water mains, 141 million gallons of covered storage in 40 reservoirs, and 29 pumping stations, further protecting its quality.

IMPORTANT!

If appropriate, please post this report so that others may view its contents. Additional copies may be obtained by contacting the District at (760) 735-4500.

Valley Center Municipal Water District's WATER SOURCES



Physical: 29300 Valley Center Rd • Valley Center, CA 92082

Mailing: P.O. Box 67 • Valley Center, CA 92082

Phone: (760) 735-4500


Website: www.valleycenterwater.org

Email: vcwater@vcemd.org

Annual WATER QUALITY REPORT

2025 Calendar Year CONSUMER CONFIDENCE REPORT

*Annual Report on Water Quality
for 2025*

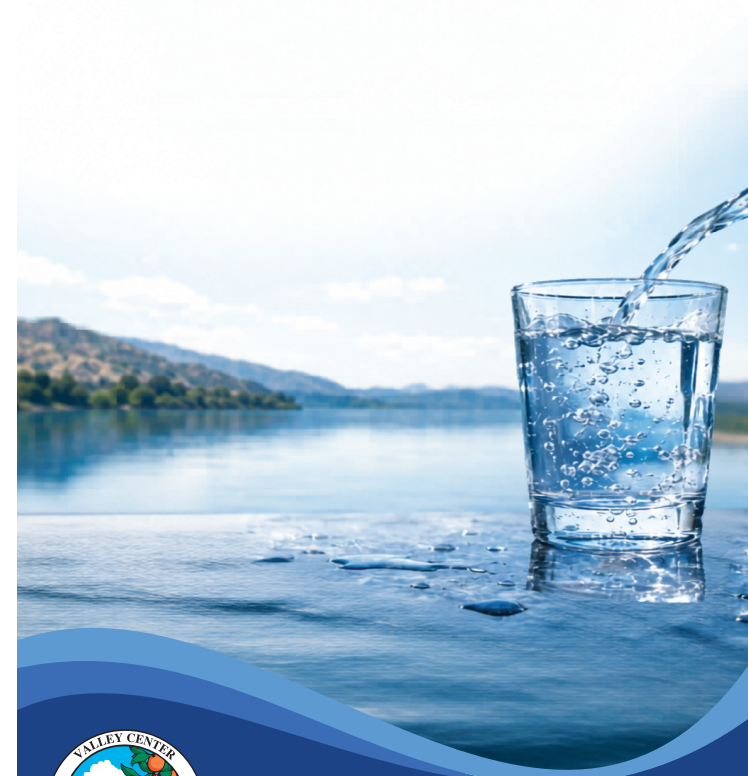

**VALLEY CENTER MUNICIPAL
WATER DISTRICT**

2025 Water Quality Data Valley Center Municipal Water District

Our water quality information for 2025 is listed in the tables on this page. Contained in the table are the test results for clarity and microbiological safety. Also included are results for 10 inorganic and secondary standards (aesthetic). Finally, the table includes results for additional "other parameters" for which there are no current state or federal standards.

What do all the abbreviations mean?

A number of abbreviations are contained on the Water Quality tables which are important to your understanding of the data, and those are:

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.

Maximum Residual Disinfectant Level or MRDL.

Maximum Residual Disinfectant Level Goal or MRDLG.

Public Health Goal or PHG: The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Primary Drinking Water Standard or PDWS: MCLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Secondary Drinking Water Standards (SDWS): MCLs for contaminants that affect taste, odor, or appearance of the drinking water. Contaminants with SDWS do not affect the health at the MCL levels.

Regulatory Action Level (AL): The concentration of contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

2025 ABBREVIATIONS

- A = Absence
- AI = Aggressive Index
- AL = Action Level: the concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow
- CFU/mL = Colony-forming units per milliliter
- DBP = Disinfection Byproducts
- DLR = Detection Limits for purposes of Reporting
- HPC = Heterotrophic Plate Count
- LRAA = Locational Running Annual Average
- MCL = Maximum Contaminant Level
- MCLG = Maximum Contaminant Level Goal
- MRDL = Maximum Residual Disinfectant Level
- MRDLG = Maximum Residual Disinfectant Level Goal
- MRL = Method Reporting Limit
- N = Nitrogen
- NA = Not Applicable
- ND = Non Detectable
- NL = Notification Level
- NTU = Nephelometric Turbidity Units is a measure of the suspended material in water
- P = Presence
- pCi/L = Pico Curies per liter (a measure of radiation)
- PHG = Public Health Goal
- ppb = Parts per Billion
- ppm = Parts per Million
- ppt = Parts per Trillion
- SI = Saturation Index
- TOC = Total Organic Carbon
- TON = Threshold Odor Number
- TT = Treatment Technique: a required process intended to reduce the level of a contaminant in drinking water
- µS/cm = Micromhos per centimeter

(l) Metropolitan Water District was in compliance with all provisions of the State's Fluoridation System Requirements. For additional information, visit the Health Department's fluoridation website: www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Fluoridation.html

(m) VCMWD had no total coliform present samples in 2025. As a result, the MCL was not violated. Samples are collected every Monday, and the number collected per month is either 32 or 40.

(n) Constituent categories identified as **VCMWD** indicate that water quality testing was conducted by VCMWD. Other constituent sampling was conducted by the District's wholesale suppliers, the MWD and the SDCWA.

PARAMETER (a)	Units	MCL [MRDL]	PHG (MCLG) [MRDLG]	Skinner Treatment Plant Test Results		Twin Oaks Treatment Plant Test Results		Carlsbad Desalination Plant Test Results		Major Sources in Drinking Water
				Range	Average	Range	Average	Range	Average	
PRIMARY STANDARDS – MANDATORY HEALTH RELATED STANDARDS										
CLARITY										
Combined Filter Effluent Turbidity	NTU %	TT = 1 TT(b)	NA	Highest % <0.3	0.07 100%	0.01-0.1 % <0.1	0.02 100%	Highest % <0.1	0.06 100%	Soil runoff
INORGANIC CHEMICALS										
Arsenic	ppb	10	0.004	ND	ND	NA	NA	ND	ND	Natural deposits erosion, glass and electronics production wastes
Nitrate (as N) (i)	ppm	10	10	ND	ND	ND-0.5	ND	ND	ND	Runoff and leaching from fertilizer use; sewage; natural deposit erosion
Fluoride Treatment-related (l)	ppm	2.0	1	0.6-0.8	0.7	0.2 - 0.7	0.6	0.569 - 0.874	0.694	Water additive for dental health
RADIOLOGICAL										
Uranium	pCi/L	20	0.43	ND-3	2	1.7 - 2.8	2.3	ND	ND	Erosion of natural deposits
DISINFECTION BY-PRODUCTS, DISINFECTANT RESIDUALS, AND DISINFECTION BY-PRODUCTS PRECURSORS										
VCMWD Total Trihalomethanes (e)	ppb	80	NA	VCMWD Distribution System		Highest LRAA		By-product of drinking water chlorination		
				Range	Average	Range	Average			
				14.0-50.0			32			
VCMWD Haloacetic Acid (d)	ppb	60	NA	VCMWD Distribution System		Highest LRAA		By-product of drinking water chlorination		
				Range	Average	Range	Average			
				0.0-17.0			12			
VCMWD Total Chlorine Residual (Chloramines)	ppm	[4.0]	[4.0]	VCMWD Distribution System		Average		Drinking water disinfectant added for treatment		
				Range	Average	Range	Average			
				1.5-2.1			1.94			
CONTAMINANTS MONITORED BUT NOT DETECTED										
VCMWD Total Coliform Bacteria (c) (m)	%	5.0	0	VCMWD Distribution System		Average		Naturally present in the environment		
				Range	Average	Range	Average			
				ND			ND			
VCMWD Fecal Coliform Bacteria and E. Coli (c) (m)	CFU /mL	0	0	VCMWD Distribution System		Average		Human and animal fecal waste		
				Range	Average	Range	Average			
				ND			ND			
INORGANIC CHEMICALS										
VCMWD Copper (f) Triennial 2025	ppm	AL = 1.3	0.3	VCMWD Distribution System		90 th Percentile		Internal corrosion of household plumbing; natural deposit erosion		
				Range	Average	Range	Average			
							0.26			
VCMWD Lead (f) Triennial 2025	ppb	AL = 15		VCMWD Distribution System		90 th Percentile		Internal corrosion of household plumbing; natural deposit erosion		
				Range	Average	Range	Average			
							9.8			
SECONDARY STANDARDS – AESTHETIC STANDARDS										
				Skinner TP		Twin Oaks TP		Carlsbad DP		
				Range	Average	Range	Average	Range	Average	
Chloride	ppm	500	NA	87-91	89	NA	NA	59-110	85	Runoff/leaching from natural deposits; seawater influence
Specific Conductance	µS/cm	1600	NA	824-847	836	840	840	235.1-530.9	442.9	Substances that form ions in water; seawater influence
Sulfate	ppm	500	NA	164-171	168	100-160	146	12.0-15.0	13.5	Runoff/leaching from natural deposits; industrial waste
Total Dissolved Solids (TDS)	ppm	1000	NA	501-513	507	250-490	337	105-310	239	Runoff/leaching from natural deposits; seawater influence
OTHER PARAMETERS										
Alkalinity (as CaCO ₃)	ppm	NA	NA	105-108	106	120	120	46-83	62	
Boron	ppb [ppm]	NL= 1000	NA	130	130	NA	NA	0.51-0.92	0.69	Runoff/leaching from natural deposits; industrial waste
Calcium	ppm	NA	NA	54-55	54	NA	NA	17.4-68.5	24.3	
Corrosivity (k) (as Aggressive Index)	AI	NA	NA	12.3	12.3	NA	NA			Elemental balance in water; affected by temperature, other factors
Corrosivity (g) (as Saturation Index)	SI	NA	NA	0.48-0.57	0.52	NA	NA	0.07-0.59	0.34	Elemental balance in water; affected by temperature, other factors
Hardness (CaCO ₃)	ppm	NA	NA	228-232	230	NA	NA	54.4-69.0	60.5	Runoff/leaching from natural deposits; sum of polyvalent cations, generally magnesium & calcium present in water
Magnesium	ppm	NA	NA	21	21	NA	NA	1.2-1.7	1.4	Runoff/leaching from natural deposits
pH	Units	NA	NA	8.2	8.2	7.4-9.0	8.5	8.32-8.63	8.51	
Potassium	ppm	NA	NA	4.2 - 4.4	4.3	NA	NA	0.000-49.510	31.239	Salt present in the water, naturally occurring
Sodium	ppm	NA	NA	83-87	85	NA	NA	47.8-62.1	57.4	Various natural and man-made sources
Total Organic Carbon (TOC)	ppm	TT	NA	2.0-2.8	2.6	1.8-2.3	2.1	NA	NA	Various natural and man-made sources
VCMWD Color	Units	15	NA	VCMWD Distribution System		Average		Naturally occurring organic materials		
				Range	Average	Range	Average			
				ND			ND			
VCMWD Odor Threshold (h)	TON	3	NA	VCMWD Distribution System		Average		Naturally occurring organic materials		
				Range	Average	Range	Average			
				ND			ND			
VCMWD Turbidity (b)	NTU	5	NA	VCMWD Distribution System		Average		Soil runoff		
				Range	Average	Range	Average			
				ND - 0.99			0.054			
UCMR 5(j) (Unregulated Contaminant Monitoring Rule) (2024)										
PARAMETER	Units	MCL	[DLR] MRL	Test Results						
				Range	Average	Range	Average			
Lithium	ug/l	NA	9	35-40	37					

2025 FOOTNOTES

- (a) Data shown are annual averages and ranges.
- (b) As Primary Standards, the turbidity level of the filtered water shall be less than or equal to 0.3 NTU in 95% of the measurements taken each month and shall not exceed 1.0 NTU for more than one hour. Turbidity is a measure of the cloudiness of the water and is an indicator of treatment performance.
- (c) Total coliform MCLs: No more than 5.0% of the monthly samples may be total coliform positive. When collecting <40 samples, if two or more are total coliform positive, the MCL is violated. The MCL was not violated. E. coli MCLs: The occurrence of 2 consecutive total coliform positive samples, one of which contains fecal coliform/E. coli, constitutes an acute violation. Standards and results are based on distribution system monthly sampling averages. Compliance is based on distribution system sampling from all pressure zones. 416 samples were analyzed in 2025. The MCL was not violated.
- (d) Calculated from the average of quarterly samples. Compliance is based on a running annual average of 16 distribution system samples. VCMWD was in compliance with the Stage 2 Disinfection By-Products (D/DBP) Rule.
- (e) Calculated from the average quarterly samples. Compliance is based on a running annual average of 16 distribution system samples. VCMWD was in compliance with the Stage 2 Disinfection By-Products (D/DBP) Rule.

- (f) Lead and copper are regulated in a Treatment Technique under the Lead and Copper Rule. The lead and copper results for 2025 are from 30 water samples collected from the consumers' tap throughout the VCMWD distribution system. The federal action level, which triggers water systems into taking treatment steps if exceeded in more than 10% of the tap water samples, is 1.3 ppm for copper and 15 ppb for lead. There were zero samples that exceeded the action level.
- (g) Positive SI index = non-corrosive; tendency to precipitate and/or deposit scale on pipes
Negative SI index = corrosive; tendency to dissolve calcium carbonate.
- (h) Results are from VCMWD's laboratory's flavor-profile analysis that detects odor occurrences more accurately.
- (i) State MCL is 45 ppm as nitrate, which equals 10 ppm as (N).
- (j) In 2025, the USEPA required VCMWD to test for a specific list of compounds. VCMWD is required to report the results on this CCR in order to comply with State of California reporting requirements.
- (k) AI <10.0 = highly aggressive and very corrosive water
AI >12.0 = non-aggressive water
AI (10.0 - 11.9) = moderately non-aggressive water

VALLEY CENTER MUNICIPAL WATER DISTRICT ~ 2025 WATER QUALITY REPORT

Este informe contiene información muy importante sobre su agua. Tradúzcalo ó hable con alguien que lo entienda bien.

Valley Center Municipal Water District (VCMWD) is committed to supplying safe water that meets or surpasses state and federal safety standards and achieves the highest standards of customer satisfaction. **The U.S. Environmental Protection Agency (EPA) and the California State Division of Drinking Water (DDW) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems and require the publication and distribution of this report to our customers and the community we serve.**

We are pleased to report that the quality of water delivered by the Valley Center Municipal Water District meets or exceeds all State and Federal standards. **Your tap water is safe to drink.**

This report is a snapshot of the water quality of VCMWD's water deliveries in calendar year 2025. Included are details about where the water comes from, what it contains, and how it compares to the DDW standards. If you are interested in more information about your water supply or water supplier, please feel free to contact our administrative offices at 760-735-4500, reach us on our website: www.valleycenterwater.org (which includes links to Metropolitan and the San Diego County Water Authority) or attend one of our Board meetings on the 1st and 3rd Mondays of each month at 2:00 p.m. Meetings are held at the District Offices, 29300 Valley Center Rd., Valley Center, and are open to the public.

For specific questions or information about water quality, please contact our Field Operations Department and ask for Michael Nichols or Brian Lovelady (760-735-4512).

WATER QUALITY INFORMATION

Generally, the sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, seawater desalination and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in the source water include:

- 💧 **Microbial contaminants**, such as viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- 💧 **Inorganic contaminants**, such as salts and metals, that can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- 💧 **Pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.
- 💧 **Organic chemical contaminants**, including synthetic and volatile organic chemicals that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.
- 💧 **Radioactive contaminants**, which can be naturally-occurring or be the result of oil and gas production and mining activities.

ARE THERE ANY PRECAUTIONS THE PUBLIC SHOULD CONSIDER?

As previously stated, the water supplied by VCMWD meets or exceeds all State and Federal safety standards and is safe to drink. However, all drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. In order to ensure that tap water is safe to drink, EPA and DDW prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. **More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791) or by viewing the USEPA's website at www.epa.gov/safewater.**

DDW regulations also establish limits for contaminants in bottled water that must provide the same protection for public health.

Some people may be more vulnerable to contaminants in drinking water than the general population. **Immunocompromised persons** such as persons with **cancer undergoing chemotherapy**, persons who have undergone **organ transplants**, people with **HIV/AIDS** or other **immune system disorders**, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. **EPA/Centers for Disease**

Control (CDC) guidelines on appropriate means to lessen the risk of infection by cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

Lead, if present and at elevated levels, can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The VCMWD is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

WHAT IS YOUR WATER SUPPLIER DOING TO KEEP THE TAP WATER SAFE?

Under the guidance of the DDW, the VCMWD regularly conducts over 400 tests from 21 strategically positioned sample points to guarantee a safe level of disinfectant residual and the bacteriological safety of your water supply. We also monitor our supply for the levels of Trihalomethanes and Haloacetic Acids, which are disinfection byproducts and are suspected to be human carcinogens. Finally, the District administers an active and aggressive Backflow Prevention Program, which protects our water supply from the possibility of contamination coming from the customer's side of the meter.

In addition to our water quality efforts, the Metropolitan Water District performs over 300,000 analyses each year to monitor over 115 contaminants and characteristics of its supplies, including tests for water clarity (Turbidity), organic chemicals (pesticides, PCBs), volatile organic compounds, inorganic compounds, disinfection byproducts (DBPs), disinfectant residuals and radionuclides. Metropolitan also monitors for contaminants that are not yet regulated (i.e., assigned a safety limit) to help the EPA and DDW determine where certain contaminants occur and whether the contaminants need to be regulated in the future.